




DA
R1000

DAB
R1000


DAB
R1000

VISSMANN

CONTROL
PANEL
REPAIR
INSTRUCTIONS
SEE USER MANUAL

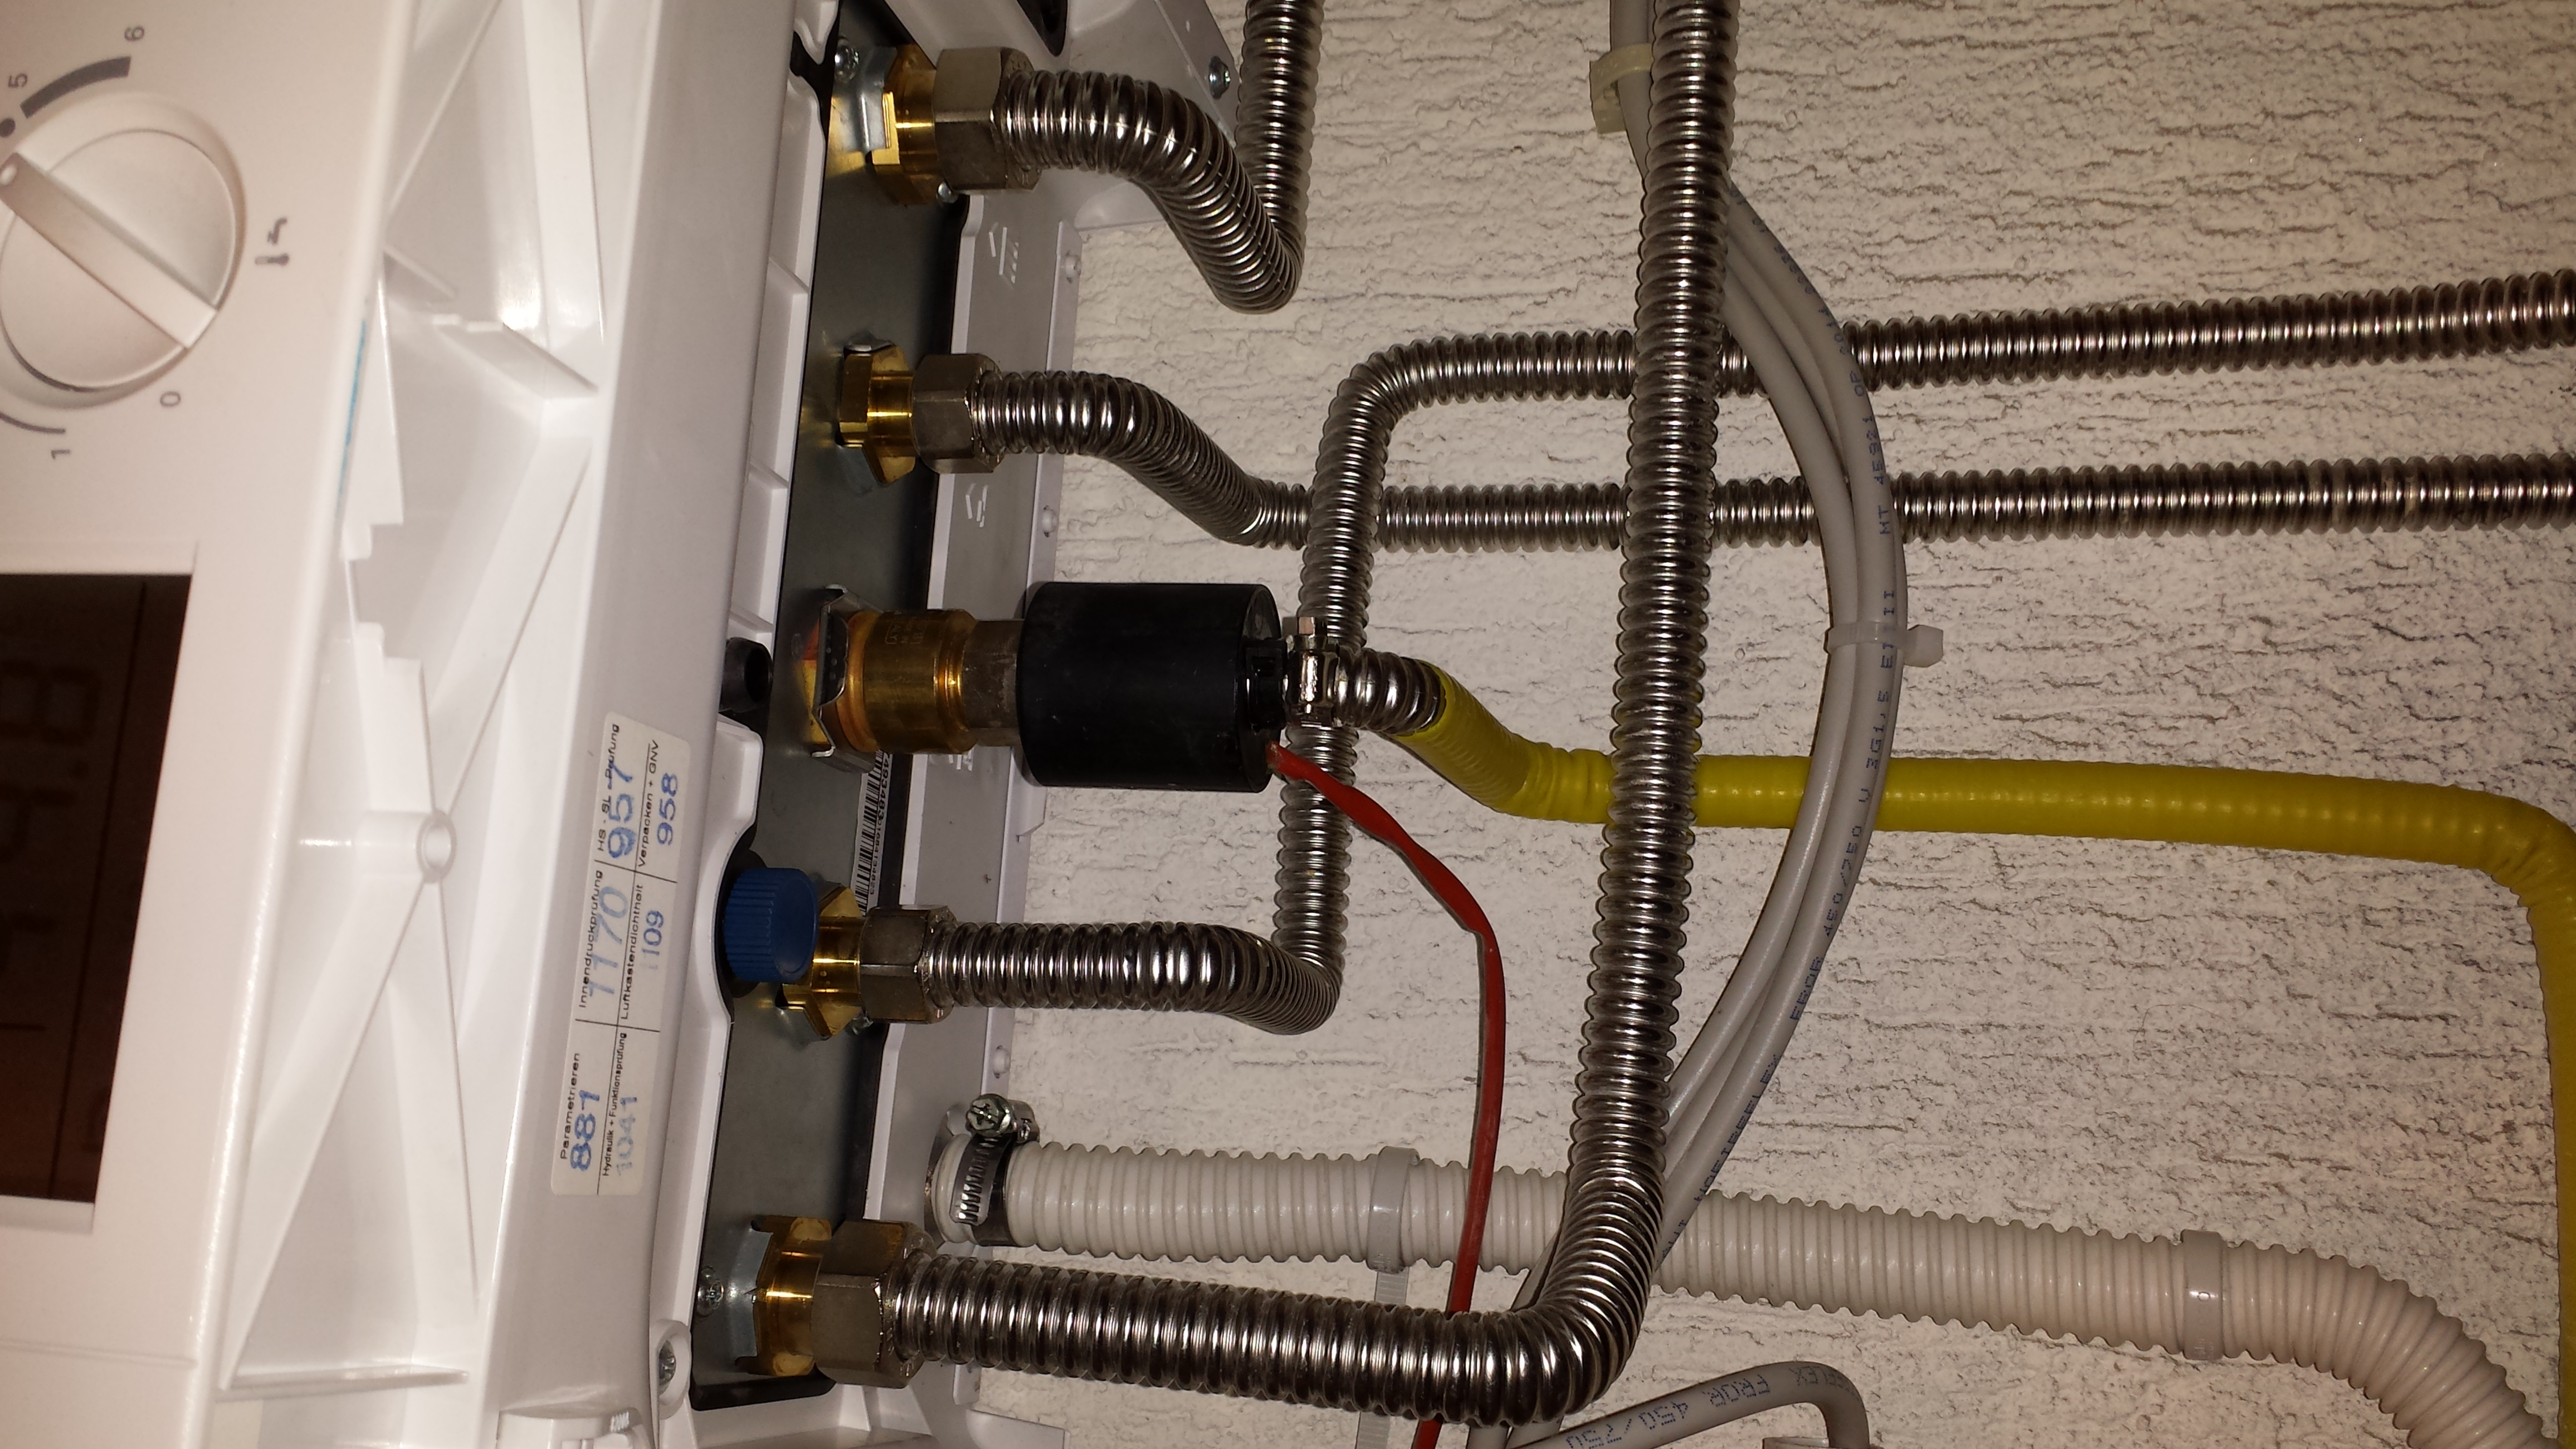



| | | |
|------------------------------|---------------------|-------------------|
| Parametrieren | Innendruckprüfung | HS - SL - Prüfung |
| 887 | 1170 | 957 |
| Hydraulik + Funktionsprüfung | Luftkastendichtheit | Verpacken + GNV |
| 1041 | 109 | 958 |

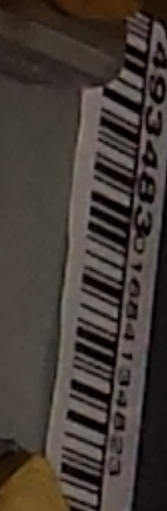

FROR 450/750

MT 450/750 U 501,5 E11

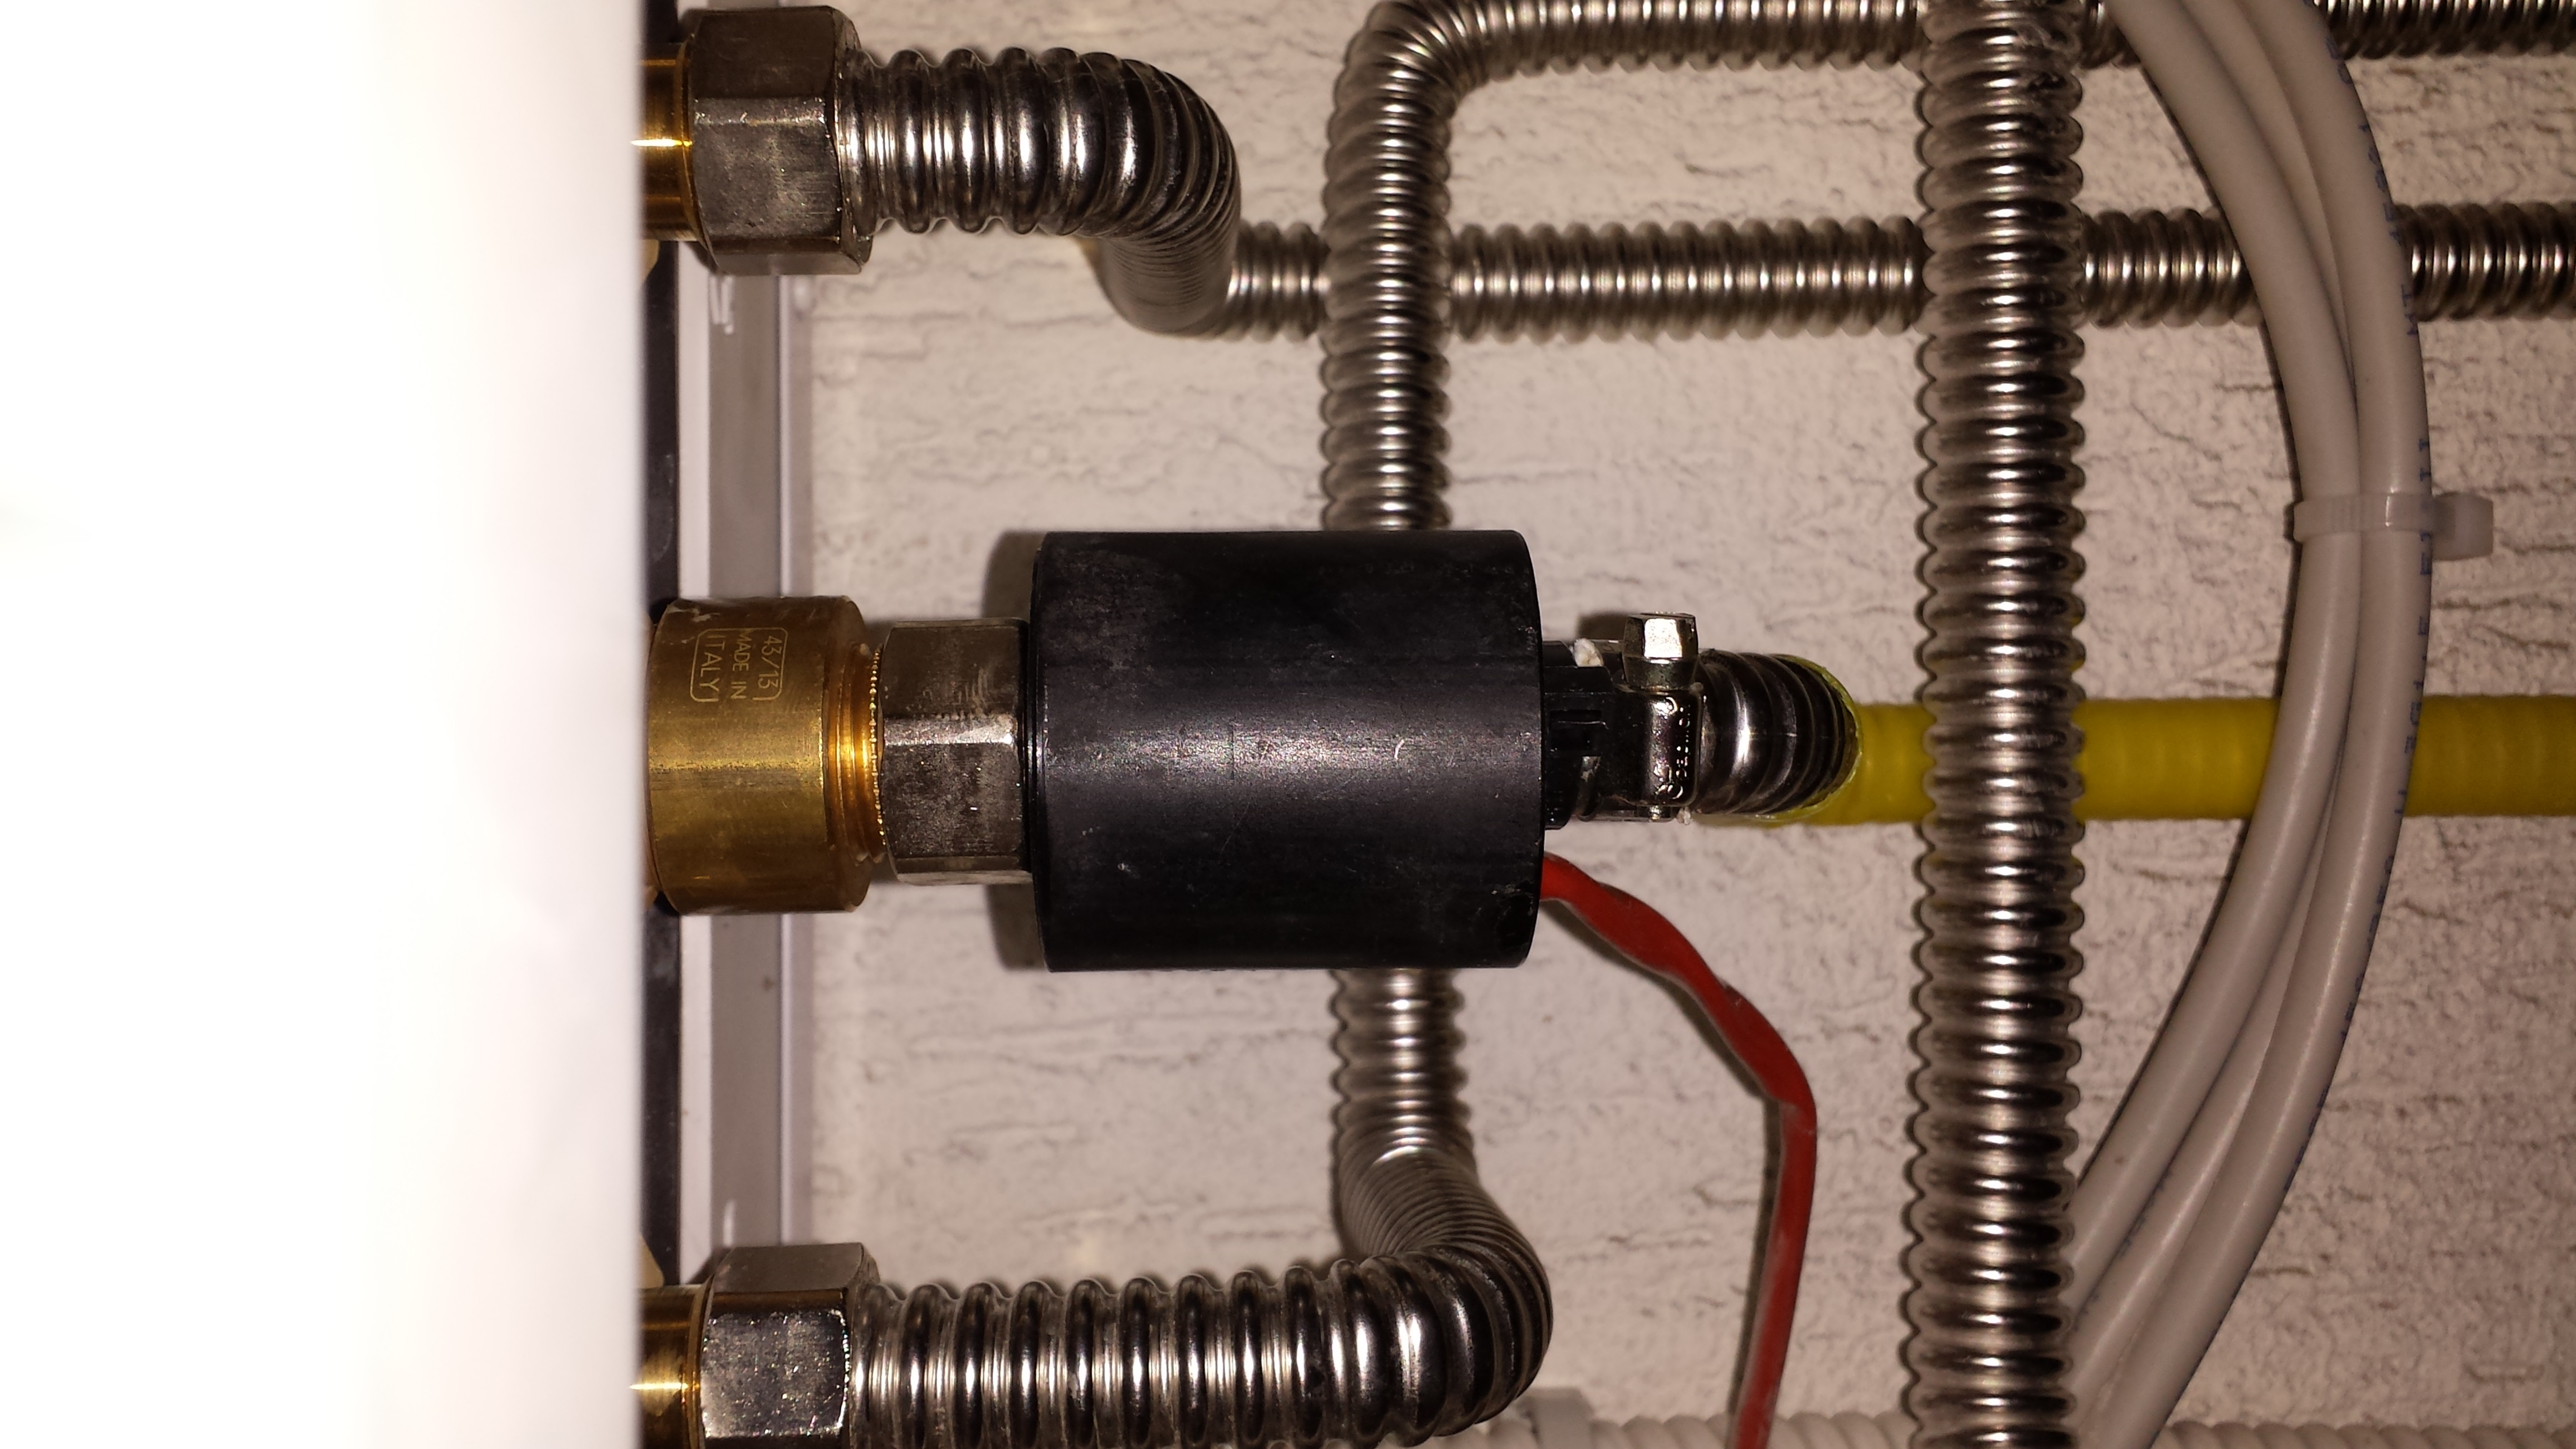

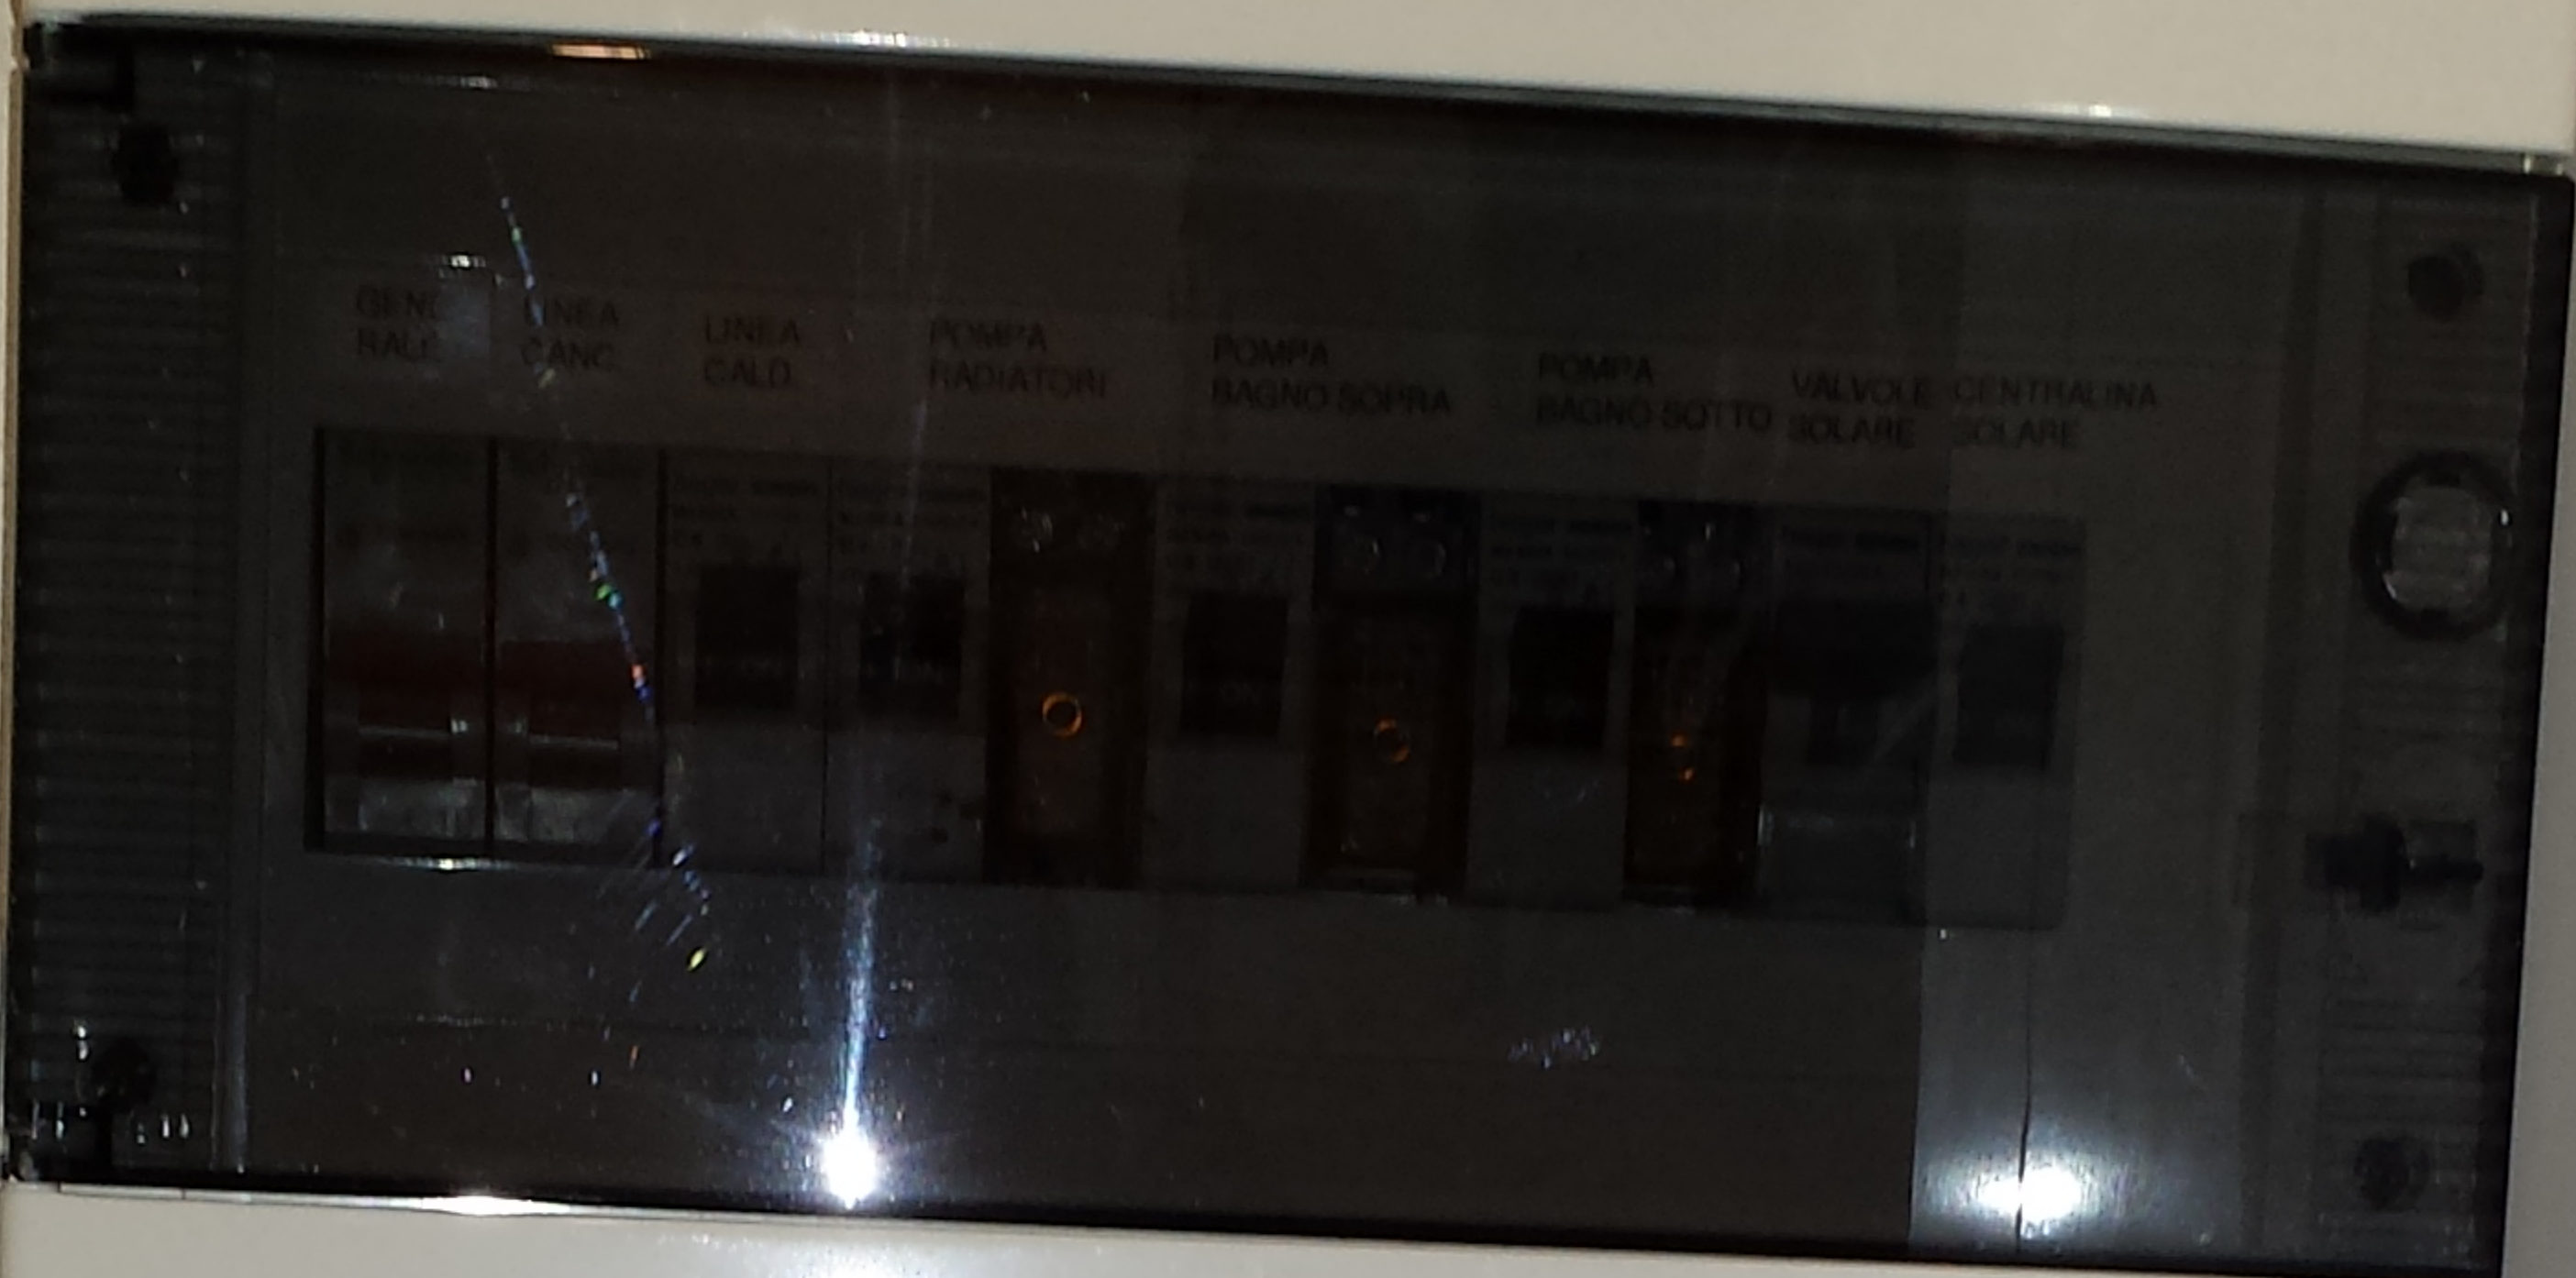

CENTRO TECNICO MENEGAZZO s.r.l.
riscaldamento - condizionamento - apparecchiature tecniche
Via Conegliano, 94/A - 31058 SUSEGANA TV
Tel. 0438 450269-71 - Fax 0438 450283
www.ctmenegazzo.com

